


COMPUTER SYSTEMS  
SERVER ROOM (Ground Floor)

date: March 2002  
 revision: April 2003  
 drawn by: C.C.


drawing no: STD - A22.1  
 elementary

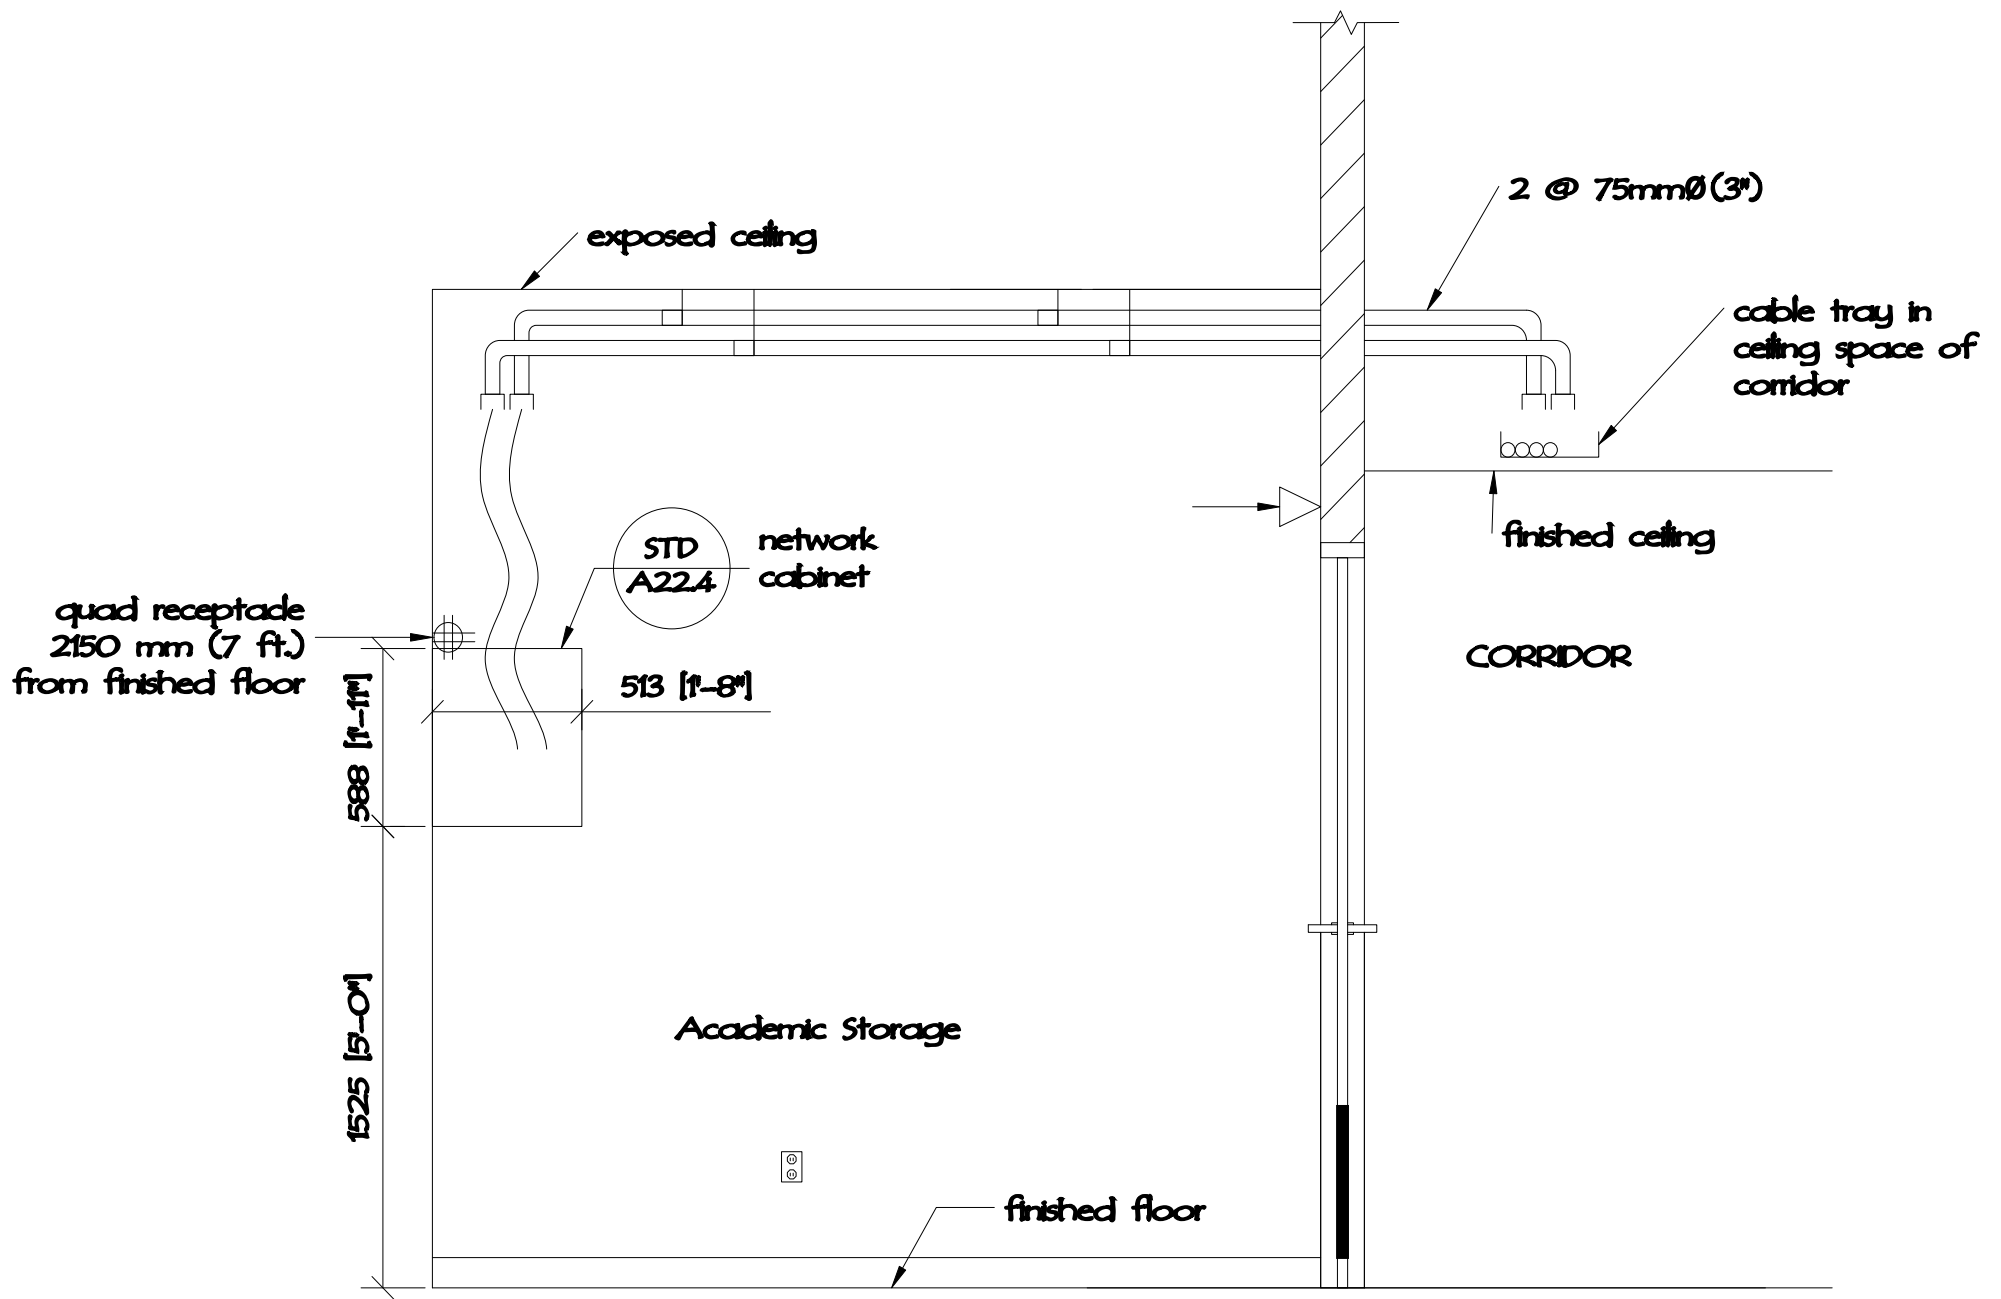

**COMPUTER SYSTEMS**  
Typical Location of Network Cabinet (2nd floor)

revision: January 2004  
drawn by: EF.

drawing no: STD - A22.2  
elementary


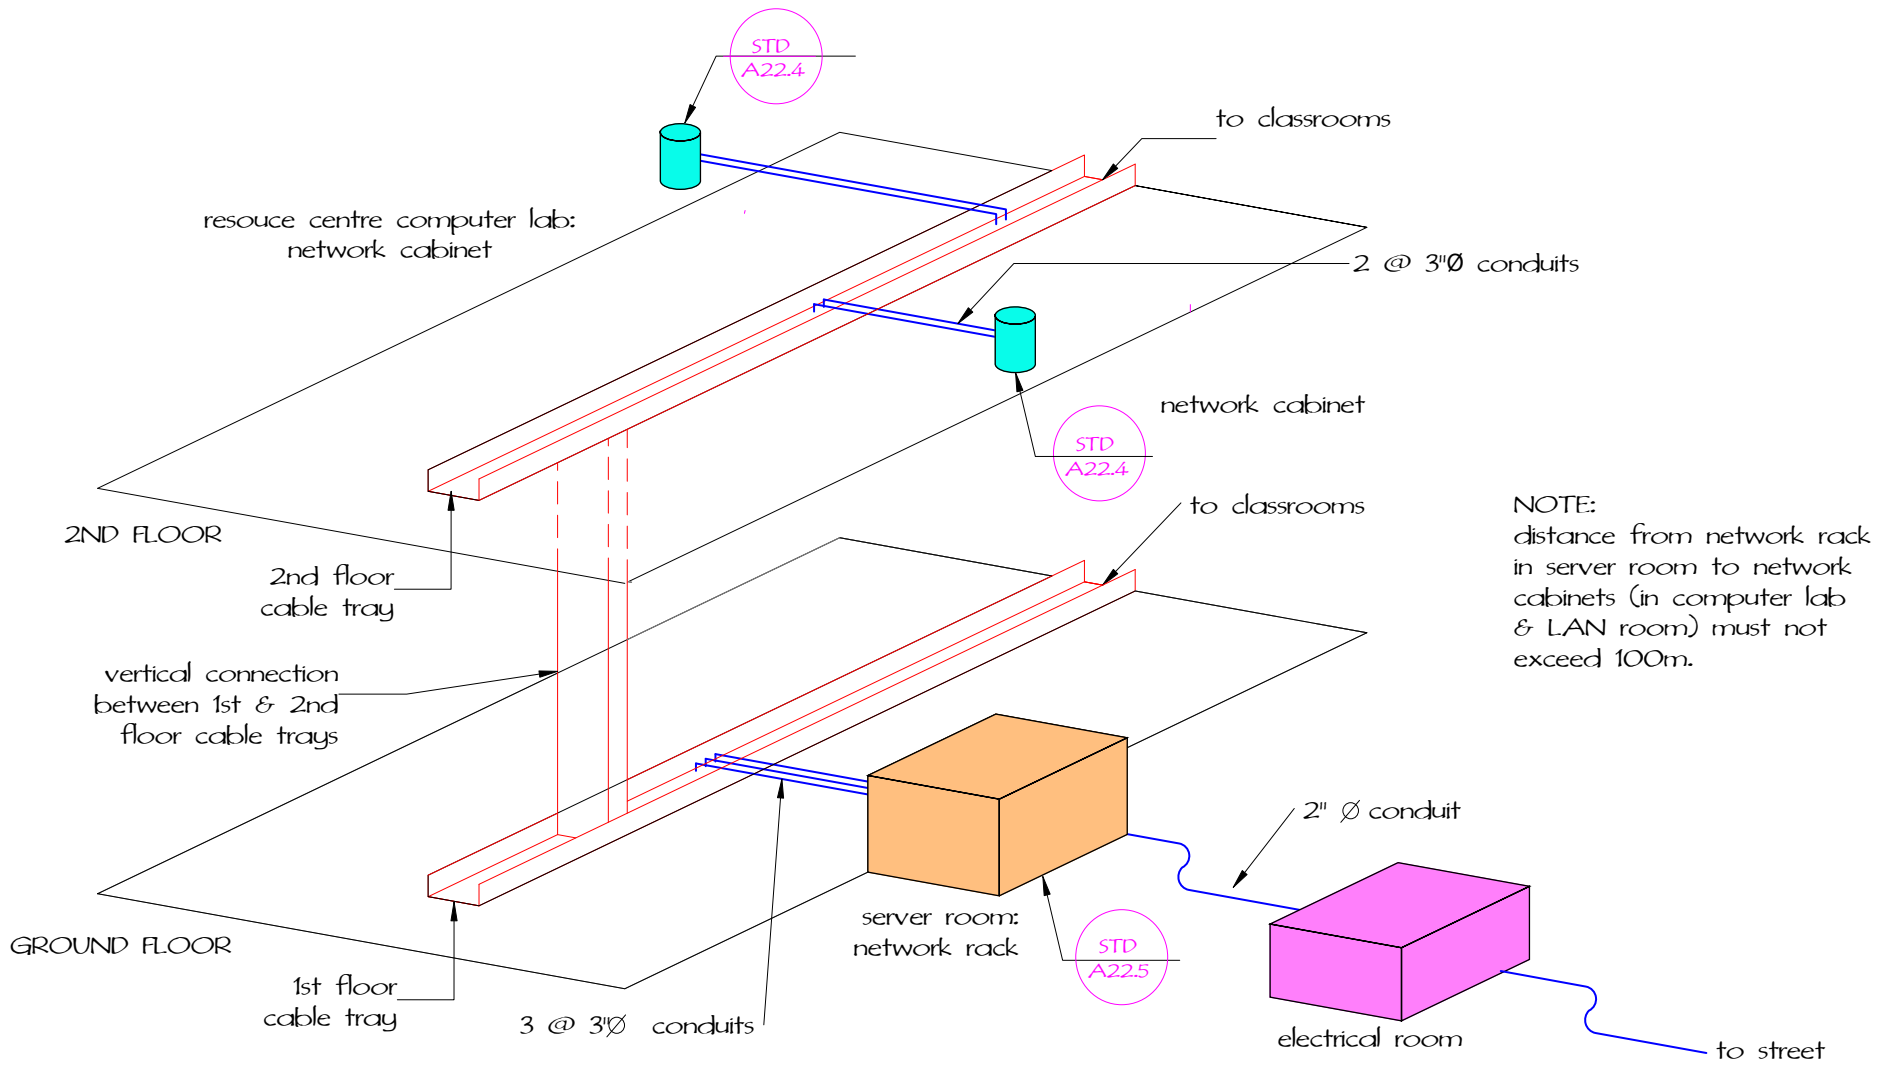


COMPUTER SYSTEMS  
DISTRIBUTION SCHEMATIC

revision: January 2004  
drawn by: E.F.

drawing no: STD - A22.3  
elementary



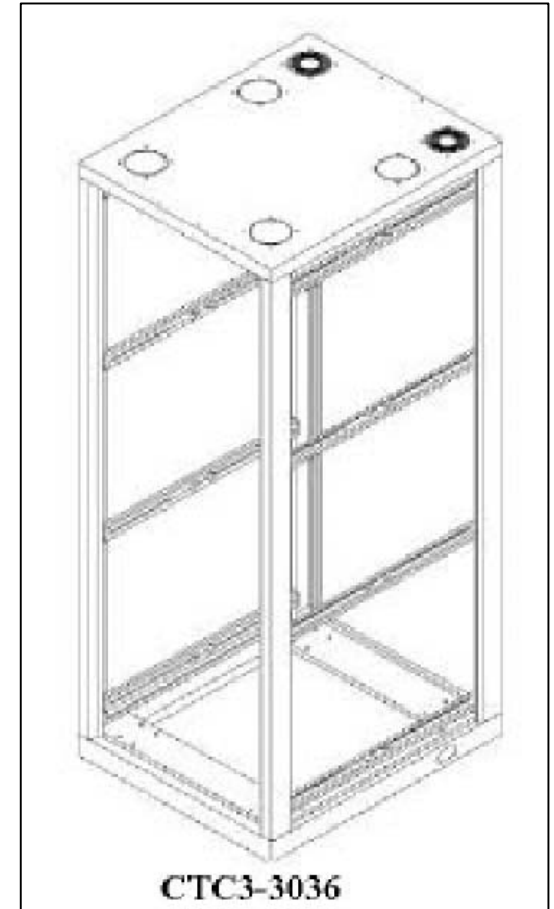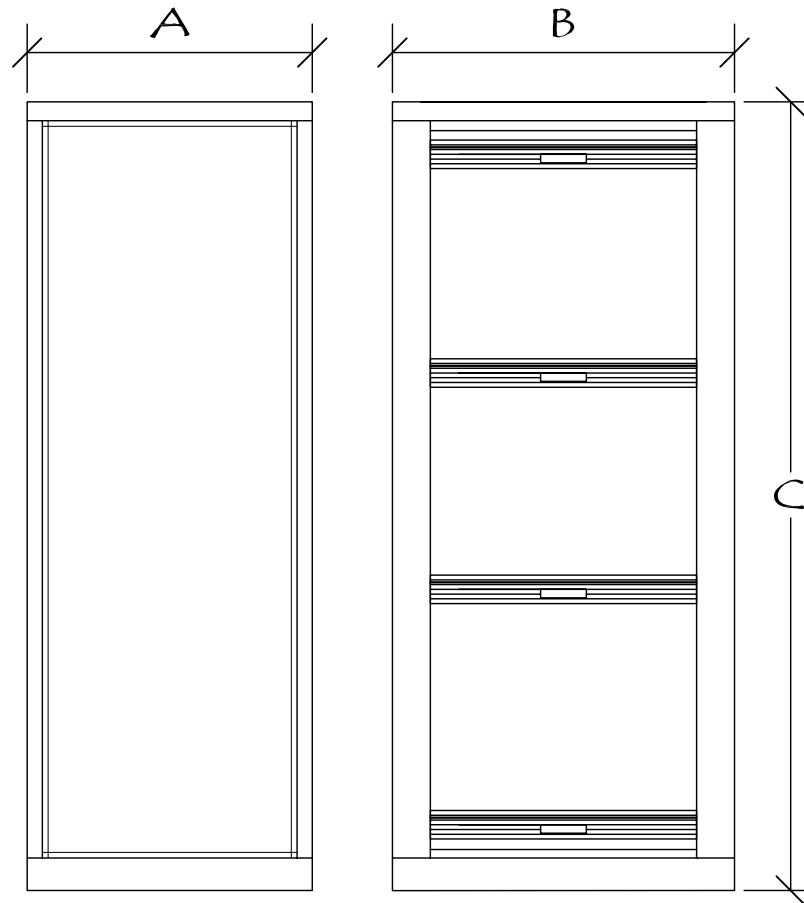

**Communication Cabinet Specification**

Part Number	Width (A)	Depth (B)	Height(C)	U-Space	Description
CTC3-3036	750mm (30")	900mm (36")	2075mm (83")	48 U	Cabinet Frame

NOTE:  
the network rack to be  
located in the server room  
(STD-A22.1)



COMPUTER SYSTEMS  
NETWORK RACK (Server Room)

date: September 2002  
revision: April 2003  
drawn by: C.C.

drawing no: STD - A22.5  
elementary



